

# Lot 10 Greene Street, Huntly

## Site Classification for Birchgrove Property

16C 0519  
August, 2016

# Lot 10 Greene Street, Huntly

## Site Classification for Birchgrove Property

### Revision

Revision	Date	Authorised
16C 0519 Lot 10	4/8/16	SEH

### Distribution (this revision only)

Recipient	Format	Date
GTSS	On file	4/8/16
Birchgrove Property Attn: Damien Tangey	Email PDF <a href="mailto:damien@birchgrove.com.au">damien@birchgrove.com.au</a>	4/8/16

## 1 INTRODUCTION

Birchgrove Property commissioned Geotechnical Testing Services to conduct a geotechnical investigation for the proposed residential development located at Lot 10 Greene Street, Huntly.

The investigation has been conducted for the purpose of assessing general subsurface conditions at the site and consequently assigning a Site Classification in accordance with AS2870 – 2011 “Residential Slabs and Footings”.

## 2 INVESTIGATION

The investigation was conducted by a technician on the 21st of July, 2016 using a vehicle mounted drill-rig and drilling 2 boreholes to depths of 1.6 to 2.5 metres within the designated area. The subsequent soil profiles are presented in page 6 and the location of the boreholes are presented on page 7.

At the time of this investigation, the type of development proposed is unknown to GTS.

## 3 SITE CONDITIONS

The site has had controlled fill (supervised and tested by GTS) placed across the site to form the current surface levels. At the time of the investigation the surface of the site was moist with a good cover of grass. There are no trees present in the near vicinity. There was no visual evidence of surface cracking or surface rock. No groundwater seepage was encountered over the investigated depths.

Full details of soil conditions are presented in the borehole logs

## 4 SITE CLASSIFICATION

After allowing due consideration to the site geology, soil conditions, the controlled fill (GTS report 15C 1040), drainage and known details of the proposed structure, the site has been classified as **Class M - D** (AS2870 – 2011).

Foundations designed in accordance with this classification are to be subject to the overriding conditions of Section 5 below.

## **5 DISCUSSION**

Particular attention should be paid to the design of footings as required by AS2870 – 2011.

In addition to the normal founding requirements arising from the above classification, particular conditions at the site dictate that the founding medium and minimum depth below existing surface levels for all footings should be as follows:

- Controlled FILL: Gravelly Sandy CLAY, medium to low plasticity, orange/pale brown/white, stiff to very stiff  
At depths below 0.1 metres

An allowable bearing pressure of 100kPa is available for edge beams, strips and stump footings founded as above. All foundations should extend a minimum of 100mm into the above founding material.

The proposed dwelling should be located a minimum distance of 1 x the mature height of all trees. This distance can be increased by 50 % for groups or lines of trees. If this distance is impeded then the size and distance from the dwelling of the tree(s) needs to be taken into account when designing the foundation.

## **6 IMPORTANT NOTES ABOUT THIS REPORT**

- The site classification presented in Section 4 assumes that the current natural drainage and infiltration conditions at the site will not be markedly affected by the proposed site development work. Care should therefore be taken to ensure that surface water is not permitted to collect adjacent to the structure and that significant changes to seasonal soil moisture equilibria do not develop as a result of service trench construction or tree root action.
- Attention is drawn to Appendix B of AS 2870 and CSIRO document, BTF 18 – “Foundation Maintenance and Footing Performance: A Homeowner’s Guide” as a guide to maintenance requirement for the proposed structure.
- This is not a comprehensive investigation nor is it economic or practical to determine every subsurface feature on the site. Although this investigation indicates that soil conditions are relatively uniform across the site, it is recommended that the base of all footing excavations be inspected to ensure that the founding medium meets that requirements referenced herein with respect to type and strength of founding materials. If further variations in descriptions in soil types, colour or depths are discovered during construction, this office should be notified immediately so that potential influence on the footings may be assessed.
- The soil colours provided in the borelogs attached may vary with soil moisture content and individual interpretation, therefore colour alone should not be used to identify these soils.

- Strength characteristics of soils often exhibit a large variation between wet and dry conditions. Soil characteristics of a soil profile are given on the soil conditions at the time of the investigation.
- In the event of significant earthworks being undertaken on the site after this investigation, this report may require an amendment if appropriate.

Should you have any further queries concerning these results, please do not hesitate in contacting this office on 5441 4881



Shane Hampton BE (Hons)  
Senior Geotechnical Engineer

Enclosed

Borehole Logs (Page 6)

Site Map (Page 7)

# Borehole Logs

Client:	Birchgrove Property	Borehole Log No.:	1-2
		Report Number:	16C 0519
		Date Drilled:	21/7/16
Project:	Lot 10 Greene Street, Huntly	Logged By:	ML
		Drilling Method	AS


Profile (mm):	* Structure: (see key)	Material Description:	Moisture Description:	Cohesion Density:	Plasticity:	Testing / Sampling:
0 To 100	Fill	BH1 Sandy SILT Brown	M to W	L	-	
100 To 400	Controlled Fill	Gravelly Sandy CLAY Orange/pale brown/white	M	ST	Medium	
400 To 700	Soil Profile	Clayey SAND Pale brown	D to M	MD	-	
700 To 1200		Gravelly Sandy CLAY Orange/brown	M	VST	Medium	
1200 To 1400	Residual Soil	Silty CLAY/SILTSTONE White/pale brown	M	VST	Medium	
1400 To 1600	Rock	SILTSTONE Extremely weathered, white	M	Soft Rock		
0 To 100	Fill	BH2 Sandy SILT Brown	M	L	-	
100 To 500	Controlled Fill	Gravelly Sandy CLAY Orange/pale brown/white	M	ST to VST	Medium To Low	
500 To 900	Soil Profile	Gravelly Clayey SAND Pale brown	D to M	MD	-	
900 To 1500		Silty CLAY Orange, trace of gravel	M	VST	Medium	
1500 To 1800	Residual Soil	Silty CLAY/SANDSTONE Pale brown/orange	M	VST	Medium	
1800 To 2500	Rock	SILTSTONE/SANDSTONE Extremely weathered, orange/pale brown	M	Soft Rock	-	

Key:

Drilling Method:	Moisture Condition	Cohesion:	Density:	Testing/Sampling:
AS - Auger Screwing	D - Dry	VS - Very Soft	VL - Very Loose	PP – Pocket Penetrometer
HA - Hand Auger	M - Moist	S - Soft	L - Loose	V – Hand Vane Sheer
	W - Wet	F - Firm	MD - Medium Dense	DCP – Dynamic Cone Penetrometer
		ST - Stiff	D - Dense	SPT – Standard Penetration Test
		VST - Very Stiff	VD - Very Dense	US – Undisturbed Sampling
		H - Hard		DS – Disturbed Sampling
		VH – Very hard		* See notes on borelog location page



FALL →

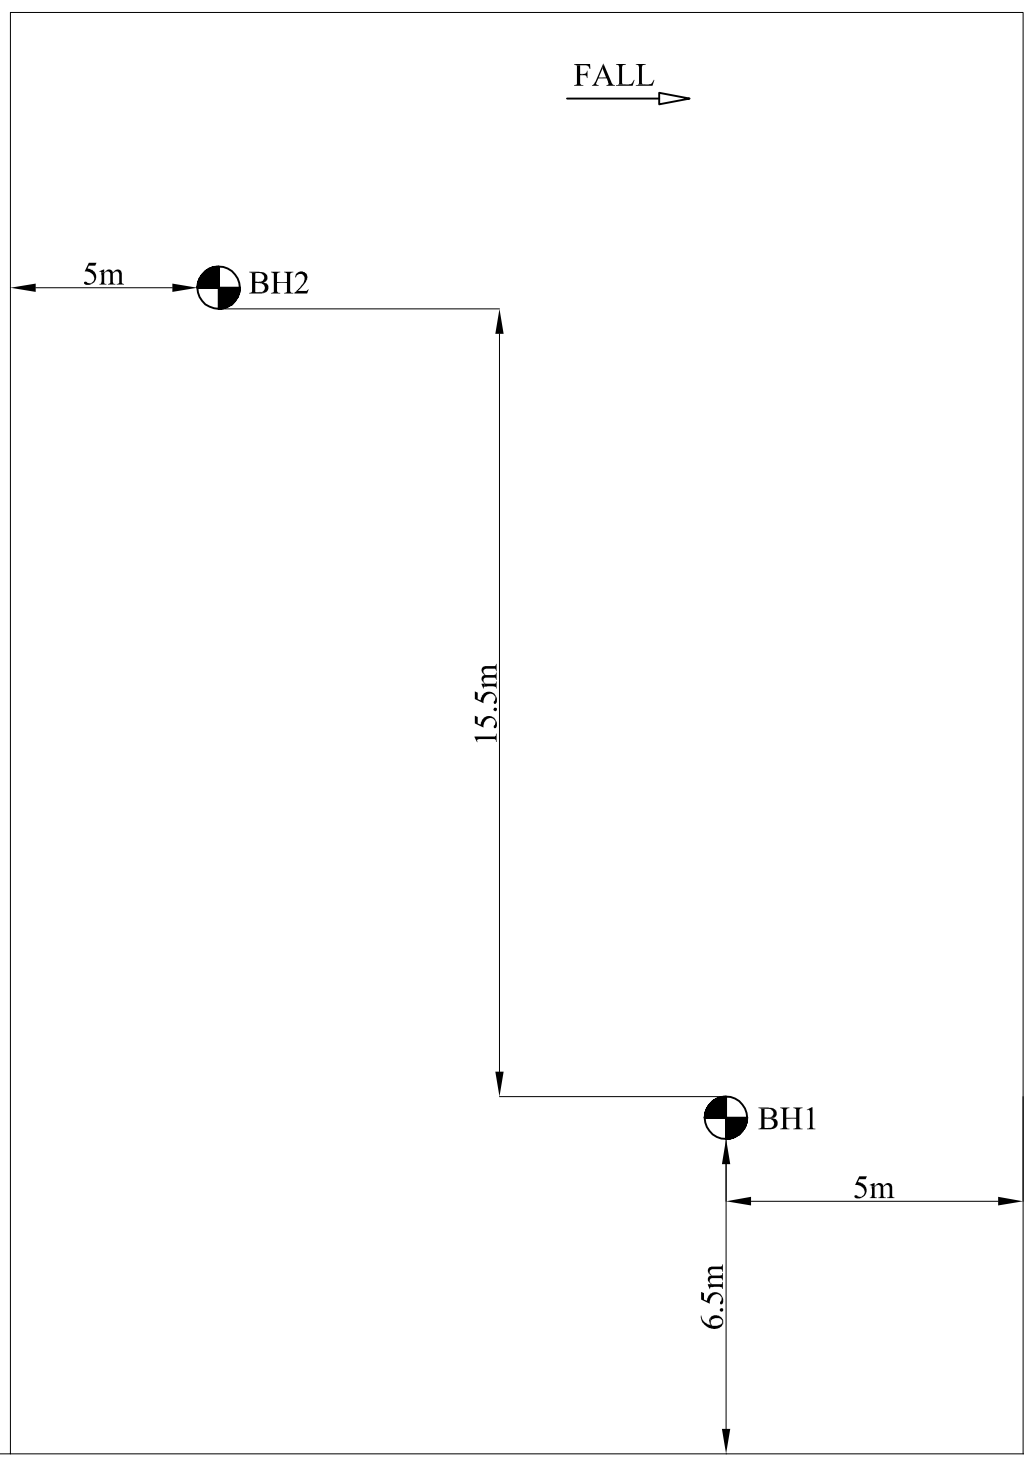

GREENE STREET



**GTS**  
GEOTECHNICAL TESTING SERVICES

**GEOTECHNICAL INVESTIGATION**

APPROXIMATE LOCATIONS  
NOT TO SCALE

**CLIENT: BIRCHGROVE PROPERTY**  
**PROJECT: LOT 10 GREENE STREET,**  
**HUNTLY**

GTS REF: 16C 0519

DATE: 21st July 2016