

# Lot 108, Canterbury Estate Stage 4 Jackass Flat

Site Classification  
for  
Arbor Estates

Report 19C 0176 (Lot 108)  
March, 2019

# Lot 108, Canterbury Estate Stage 4, Jackass Flat

## Site Classification for Arbor Estates

### Revision

Revision	Date	Authorised
19C 0176 (Lot 108)	14/03/19	SEH

### Distribution (this revision only)

Recipient	Format	Date
GTSS	On file	14/03/19
Arbor Estates	Email PDF	14/03/19

## 1 INTRODUCTION

Arbor Estates commissioned Geotechnical Testing Services to conduct a geotechnical investigation for the proposed residential development located at Lot 108, Canterbury Estate Stage 4, Jackass Flat.

The investigation has been conducted for the purpose of assessing general subsurface conditions at the site and consequently assigning a Site Classification in accordance with AS2870 – 2011 “Residential Slabs and Footings”.

## 2 INVESTIGATION

The investigation was conducted by a technician on the 12<sup>th</sup> of March 2019 using a trailer mounted drill-rig and drilling 3 boreholes to depths of 1.5 metres within the designated area. The subsequent soil profiles are presented in page 6 and the location of the boreholes are presented on page 7.

At the time of this investigation, the type of development proposed is unknown to GTS.

## 3 SITE CONDITIONS

The site has a slight fall to the front and is currently vacant. At the time of the investigation the surface of the site was dry with no grass cover. There is a row of small to medium sized trees present in the reserve outside the southern boundary. There was visual no evidence of surface cracking or surface rock. No groundwater seepage was encountered over the investigated depths.

Full details of soil conditions are presented in the borehole logs.

## 4 SITE CLASSIFICATION

After allowing due consideration to the site geology, soil conditions, the presence of trees, drainage and known details of the proposed structure, the site has been classified as **Class M-D** (AS2870 – 2011).

Foundations designed in accordance with this classification are to be subject to the overriding conditions of Section 5 below.

## **5 DISCUSSION**

Particular attention should be paid to the design of footings as required by AS2870 – 2011.

In addition to the normal founding requirements arising from the above classification, particular conditions at the site dictate that the founding medium and minimum depth below existing surface levels for all footings should be as follows:

- Silty CLAY, medium plasticity, brown, pale brown, stiff  
At depth below 0.4 metres in the region of BH1
- Silty CLAY, medium plasticity, brown, red/brown, very stiff  
At depths below 0.1 metres in the region of BH2 and BH3

An allowable bearing pressure of 100kPa is available for edge beams, strips and stump footings founded as above. All foundations should extend a minimum of 100mm into the above founding material.

## **6 IMPORTANT NOTES ABOUT THIS REPORT**

- The site classification presented in Section 4 assumes that the current natural drainage and infiltration conditions at the site will not be markedly affected by the proposed site development work. Care should therefore be taken to ensure that surface water is not permitted to collect adjacent to the structure and that significant changes to seasonal soil moisture equilibria do not develop as a result of service trench construction or tree root action.
- Attention is drawn to Appendix B of AS 2870 and CSIRO document, BTF 18 – “Foundation Maintenance and Footing Performance: A Homeowner’s Guide” as a guide to maintenance requirement for the proposed structure.
- This is not a comprehensive investigation nor is it economic or practical to determine every subsurface feature on the site. Although this investigation indicates that soil conditions are relatively uniform across the site, it is recommended that the base of all footing excavations be inspected to ensure that the founding medium meets that requirements referenced herein with respect to type and strength of founding materials. If further variations in descriptions in soil types, colour or depths are discovered during construction, this office should be notified immediately so that potential influence on the footings may be assessed.
- The soil colours provided in the borehole logs attached may vary with soil moisture content and individual interpretation, therefore colour alone should not be used to identify these soils.
- Strength characteristics of soils often exhibit a large variation between wet and dry conditions. Soil characteristics of a soil profile are given on the soil conditions at the time of the investigation.

- In the event of significant earthworks being undertaken on the site after this investigation, this report may require an amendment if appropriate.
- If FILL is found during this investigation, it is an indication of what was found during the investigation and it may vary over the site. It may be in the best interest of the buyer / seller to undertake a more detailed investigation, in this instance.

Should you have any further queries concerning these results, please do not hesitate in contacting this office on 5441 4881



Shane Hampton BE (Hons)  
Senior Geotechnical Engineer

Enclosed

Borehole Logs (Page 6)

Site Map (Page 7)


# Borehole Logs

Client:	Arbor Estates	Borehole Log No.:	1-3
		Report Number:	19C 0176 (Lot 108)
		Date Drilled:	12/03/19
Project:	Lot 108, Canterbury Estate Stage 4, Jackass Flat	Logged By:	TP
		Drilling Method	AS

Profile (mm):	* Structure: (see key)	Material Description:	Moisture Description:	Cohesion Density:	Plasticity:	Testing / Sampling:
0 To 100 To 400 To 1000 To 1500	FILL	BH1 Gravelly Sandy SILT Dark brown	D	Loose	-	
		Gravelly Silty CLAY Black, brown	M	St	Low	
	Soil Profile	Silty CLAY Brown, pale brown	M	VSt	Medium	
	Rock	SILTSTONE Extremely weathered, pale brown	D	Soft	-	
0 To 100 To 600 To 1000 To 1500	FILL	BH2 Gravelly Sandy SILT Dark brown	D	Loose	-	
		Silty CLAY Brown	M	VSt	Medium	
	Soil Profile	Silty CLAY Pale brown, yellow, some sand	M	St	Medium	
	Rock	SANDSTONE Extremely weathered, yellow/brown	D	Soft	-	
0 To 100 To 500 To 900 To 1500	FILL	BH3 Gravelly Sandy SILT Dark brown	D	Loose	-	
		Silty CLAY Red/brown, brown	M	VSt	Medium	
	Soil Profile	Silty CLAY Pale brown, some sand, traces of gravel	M	VSt	Medium	
	Rock	SILTSTONE Extremely weathered, pale brown, off white	M	Soft	-	

Key:

Drilling Method:	Moisture Condition	Cohesion:	Density:	Testing/Sampling:
AS - Auger Screwing	D - Dry	VS - Very Soft	VL - Very Loose	PP – Pocket Penetrometer
HA - Hand Auger	M - Moist	S - Soft	L - Loose	V – Hand Vane Sheer
	W - Wet	F - Firm	MD - Medium Dense	DCP – Dynamic Cone Penetrometer
		ST - Stiff	D - Dense	SPT – Standard Penetration Test
		VST - Very Stiff	VD - Very Dense	US – Undisturbed Sampling
		H - Hard		DS – Disturbed Sampling
		VH – Very hard		* See notes on borelog location page

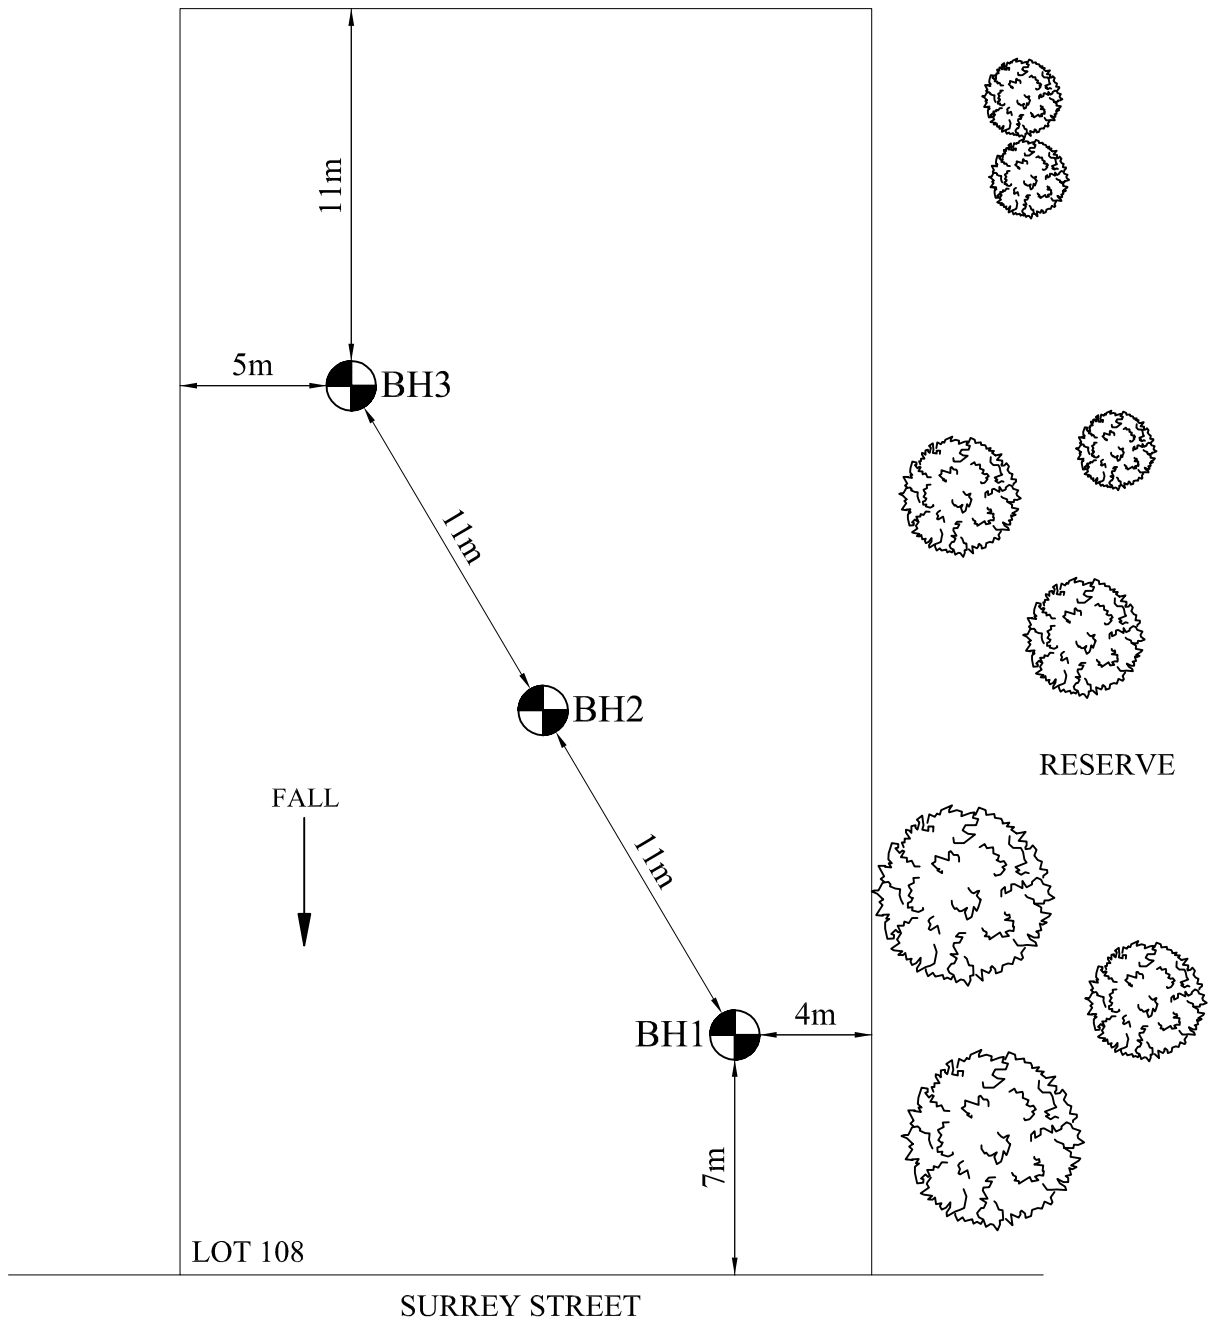

**GEOTECHNICAL INVESTIGATION**

APPROXIMATE LOCATIONS  
NOT TO SCALE

**CLIENT:** ARBOR ESTATES  
**PROJECT:** LOT 108 CANTERBURY ESTATE  
STAGE 4, JACKASS FLAT

GTS REF: 19C 0176 (LOT 108)

DATE: 14 MARCH 2019